

LUG SIZE:
H LUGS: #2-14 (*QTY: 3*; 1 PER TERMINAL)
X LUGS: 250-6AWG (*QTY: 4*; 1 PER TERMINAL)

D	03/11/2021	ADDED LUG INFO
C	08/25/2020	ADDED MTG STRAPS
B	12/13/18	DEPHT DIMENSION ADDED
A	03/07/17	INITIAL RELEASE
REV	DATE	DESCRIPTION

FINISH:

DRAWN DATE

CHECKED DATE

TOLERANCES UNLESS
OTHERWISE SPECIFIED

2-PL ± .02
3-PL ± .005
HOLES ± .030
ANGLES ± 1°

REMOVE ALL BURRS

SCALE

NTS

DRAWN BY

AS

CHK'D BY

RZ

WEIGHT:




**OVERALL ASSEMBLY
45KVA TRANSFORMER
25" ENCL.**

SHEET

1 OF 2


PART NO.

423-9214-000-CD

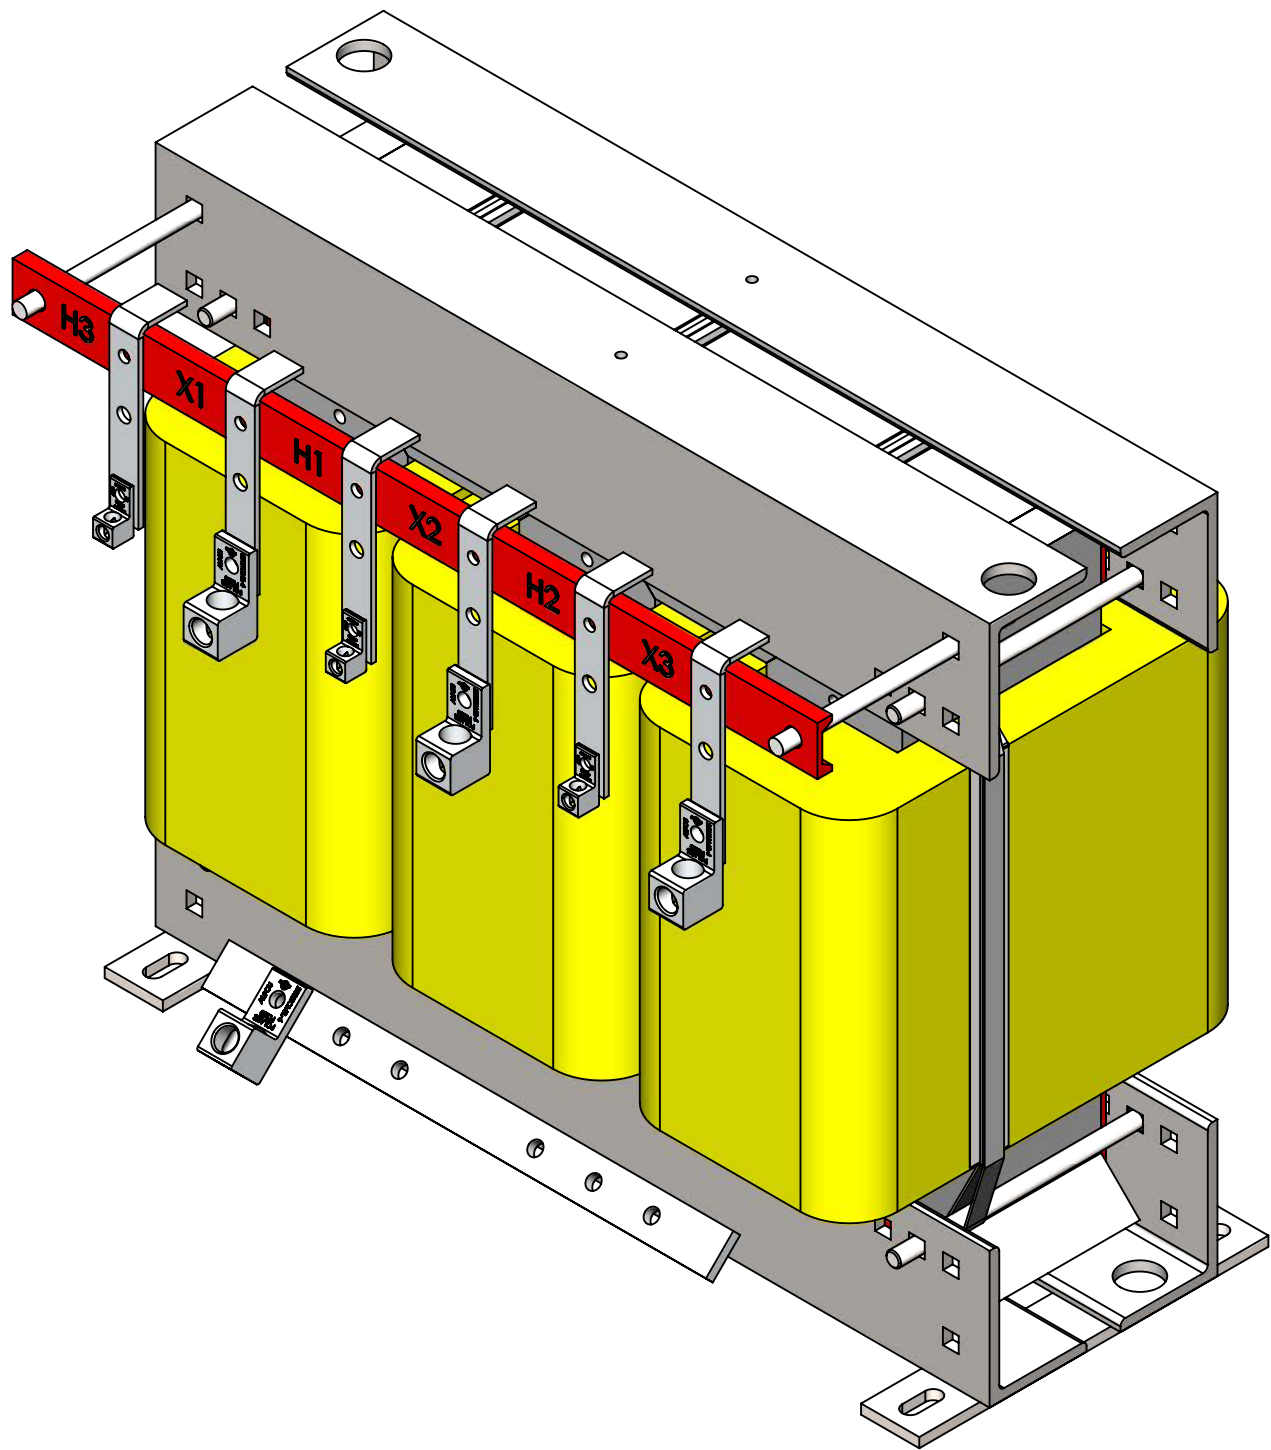

kVA 45
Phase 3
Hz 60
%IZ 3.8
Rise 150 °C
Ins. Class 220 °C
Weight 470 lbs
Class AA
Wdg. Mtl. Al

High Voltage: 480 Delta Low Voltage: 208Y/120

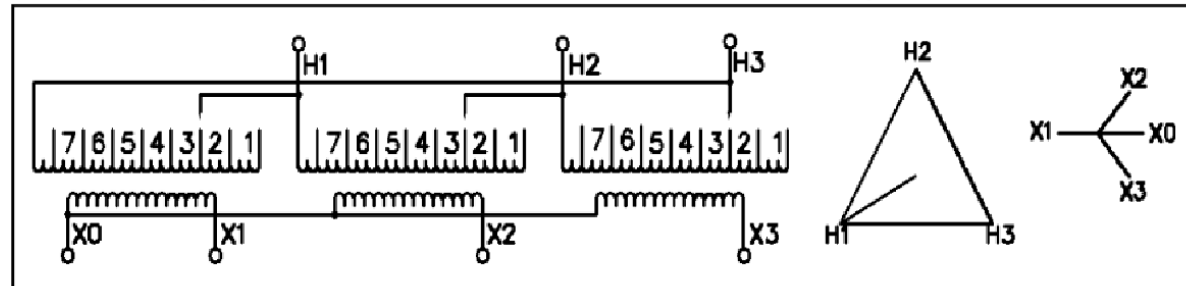

High Voltage: Lines on H1, H2, H3

Connect	1	2	3	4	5	6	7
Volts	504	492	480	468	456	444	432

Low Voltage: Lines on X1-X2-X3

Line - Line 208 V	Line - Neutral 120 V
----------------------	-------------------------

SEISMIC
QUALIFIED to IBC, CBC
SDS=1.60g, z/h=1.0, Ip=1.5
Floor mounted unit
OSHDP OSP-0109-10


Meets DOE-2016
Efficiency

423 Series

Outdoor Type 3R

Datecode: R1701 Job#: 0SRG2 SN: 0001

NOTE:
MINIMUM EFFICIENCY (35%) = 98.40
SOUND = 45db MAX.
PRIMARY AND SECONDARY MEETS
10KV BIL



OVERALL ASSEMBLY
45KVA TRANSFORMER
25" ENCL.

FINISH:

TOLERANCES UNLESS OTHERWISE SPECIFIED
2-PL ± .02
3-PL ± .005
HOLES ± .030
ANGLES ± 1°
REMOVE ALL BURRS
SCALE

NTS

DRAWN DATE

DRAWN BY

AS

CHECKED DATE

CHK'D BY

RZ

SHEET

2 OF 2

WEIGHT:

PART NO.

423-9214-000-CD

D